

Intertek ETL SEMKO

June 4, 2007

Mr. Dan Johnson
 Stuc-O-Flex International Inc.
 17639 N.E. 67th Court
 Redmond, WA 98052

Dear Dan,

Subject: Project No. 3125014COQ-001 – 2005 NBC / 2006 BCBC Letter Report

Intertek Testing Services NA Ltd. has conducted an evaluation for Stuc-O-Flex International Inc. on your WaterWay Plus and WaterWay 040 sidewall drainage products, to determine compliance with Section 9.27.2.2, Item 1b of the 2005 National Building Code of Canada (NBC) and 2006 British Columbia Building Code (BCBC). The tests were conducted in accordance with recognized ASTM test methods. The measured physical dimensions together with the relevant requirements specified in the NBC and BCBC are shown in Tables 1 and 2 below:

Table 1. WaterWay Plus (with Dow Weathermate Plus) Test Results			
Physical Property	Test Result	Requirement	Pass/Fail
Product Thickness, mm	10.4	10 min.	Pass
Cross-sectional Area, % open	87	80 min.	Pass


Table 2. WaterWay 040 Test Results			
Physical Property	Test Result	Requirement	Pass/Fail
Product Thickness, mm	10.3	10 min.	Pass
Cross-sectional Area, % open	90	80 min.	Pass

Based on the information detailed above, both WaterWay Plus and WaterWay 040 products have met the physical requirements of Section 9.27.2.2, Item 1b of the 2005 National Building Code of Canada and 2006 British Columbia Building Code.


If you require further assistance, do not hesitate to contact the undersigned directly at (604) 520-3321.

Sincerely,

INTERTEK TESTING SERVICES NA LTD.



Chris Chang, EIT
 Engineer, Construction Products

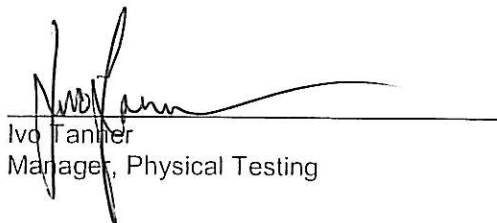

Ivo Tandler
 Manager, Physical Testing

cc/ahvs

All services undertaken are subject to the following general policy: This report is for the exclusive use of Intertek Testing Services NA Ltd.'s (Intertek's) client and is provided pursuant to the agreement between Intertek and its client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the client is authorized to copy or distribute this report and then only in its entirety. Intertek must first approve any use of the Intertek name or one of its marks for the sale or advertisement of the testing materials, product or service in writing. The observations and test results in the report are relevant only to the sample tested. This report by itself does not imply that the material, product or service is or has ever been under Intertek's certification program.



Intertek Testing Services NA Ltd.

1500 Brigantine Drive, Coquitlam, BC V3K 7C1

Telephone: 604-520-3321 Fax: 604-524-9186 Web: www.intertek-etlsemko.com